

INSTALL | ACE-N-M

FOR STATIC WHITE & RGBW




INSTALLATION INSTRUCTIONS

1. All installations must adhere to relevant electrical code requirements at the local and national levels
2. A licensed professional should preform installation to meet safety standards and electrical code requirements
3. Use only Class 2 DC constant voltage LED driver to comply with UL safety standards
4. Do not install the product underwater.
5. A dedicated driver connection is required for each maximum run.
6. The ACE-N-M can't be twisted or squeezed tight.
7. Do not cut off the cable wire of connector for customization.

MAX CONTINUOUS RUN

SW: *Every 28FT needs to be run back to the driver for 400LM/FT & Every 18FT needs to be run back to the driver for 600LM/FT

RGBW: *Every 16' need to be run back to the driver.

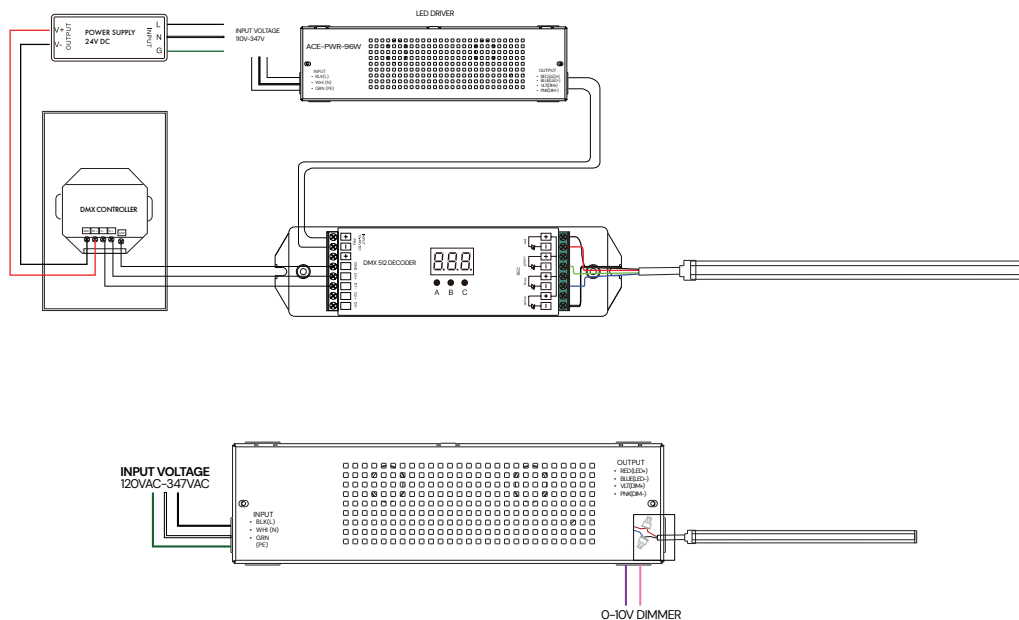

rev 01/26

© 2026 Ace Illuminations. All rights reserved.
Specifications and content subject to change without notice. Protected by international copyright laws.
info@aceilluminations.com | 702.960.4249

cont. on 1

INSTALL | ACE-N-M



MOUNTING

- The ACE-N-M can be mounted with clips or with the profile



- Screw the clips onto the surface and attach the product onto the clips.



- Screw the profile onto the surface and attach the product onto the profile.



rev 01/26

© 2026 Ace Illuminations. All rights reserved.

Specifications and content subject to change without notice. Protected by international copyright laws.
info@aceilluminations.com | 702.960.4249

cont. on 2